

CITY PLAN COMMISSION**THURSDAY, AUGUST 6, 2026****FILE NUMBER:** PLAT-26-000179**SENIOR PLANNER:** Sharmila Shrestha**LOCATION:** Plano Road, north of Lyndon B. Johnson Freeway/ Interstate Highway No. 635**DATE FILED:** July 10, 2026**ZONING:** IR**CITY COUNCIL DISTRICT:** 10**SIZE OF REQUEST:** 6.627-acres**APPLICANT/OWNER:** 10200 Plano Road, LLC

REQUEST: An application to replat a 6.627-acre tract of land containing part of Lot 1 in City Block C/8052 and City Block 8052 to create one 1.254-acre lot and one 5.373-acre lot on property located on Plano Road, north of Lyndon B. Johnson Freeway/ Interstate Highway No. 635.

SUBDIVISION HISTORY: There has been no recent platting activity within close proximity to this request.

STAFF RECOMMENDATION: The request complies with the requirements of the IR Industrial/Research District; therefore, staff recommend approval of the request subject to compliance with the following conditions:

General Conditions:

1. The final plat must conform to all requirements of the Dallas Development Code, Texas Local Government Code, Texas Land Surveying Practices Act and the General Rules and Regulations of the Texas Board of Land Surveying.
2. Department of Development Services, Engineering Division must verify that the plat conforms with the water, wastewater, and easement requirements under the provisions of Chapter 49 of the Dallas City Code.
3. Compliance with all plans, contracts, ordinances, and requirements of the City of Dallas. *Section 51A-8.102(a), (b), (c), and (d)*
4. The number and location of fire hydrants must comply with the Dallas Fire Code.
5. Any new or existing structure may not extend across new property lines. *Section 51A-8.503(e)*
6. On the final plat, all easement abandonments, and ROW abandonments must be by separate instrument with the recording information shown on the face of the plat. A release from the Real Estate Division is required prior to the plat being submitted to the Chairman for signature.
7. On the final plat, include two boundary corners tagged with these coordinates: "Texas State Plane Coordinate System, North Central Zone, North American Datum of 1983 on Grid Coordinate values, No Scale and no Projection."
8. On the final plat, monument all set corners per the Monumentation Ordinance. Prior to submitting the final plat for the Chairman's signature, the monuments

must be verified by the Chief City Surveyors Office in the Public Works Department. *Section 51A-8.617*

9. Provide ALL supporting documentation (i.e. deeds, plats, ordinances, easements...etc) with a completed Final Plat Checklist to the Survey Plat Review Group (**SPRG**) with the Final Plat Submittal **after** City Plan Commission Approval.
10. Prior to the final plat, submit a tree survey to the Arborist. A release from the arborist is required prior to an early release request or the recordation of the plat, whichever occurs first.
11. The number of lots permitted by this plat is 2.

Paving & Drainage Conditions:

12. Submit a full set of Civil Engineering Plans (drainage, paving, street signage/marketing/lighting) prepared per City Standards by a licensed (TX) Professional Engineer to Engineering Division in Room 200, Oak Cliff Municipal Center (i.e. 311T/DP). Additions and alterations to the public infrastructure require approval and may require private development contracts with bonds. 51A-8.102 (c); 8.601(b)(4),(5),(6),(7),(8),(9)
13. Detention may be required if the capacity of available outfall is not adequate to carry the developed runoff. Section 51A-8.611(c).
14. "Lot-to-Lot drainage will not be allowed without proper City of Dallas Engineering Division approval" (Note must be on the Plat). 51A 8.611(e)

Flood Plain Conditions:

15. On the final plat, determine the 100-year water surface elevation across this addition.
16. On the final plat, dedicate floodway easement, floodway management area or floodway easement (within common area), with the appropriate easement statement included on the face of the Plat. 51A 8.611(d); DWU Floodplain Management; Drainage Design Manual Addendum V
17. On the final plat, include additional paragraph in Owner's Certificate (pertaining to the floodplain). 51A 8.611(d); DWU Floodplain Management; Drainage Design Manual Addendum V
18. On the final plat, specify minimum fill and minimum finished floor elevations. *Section 51A-8.611(d), Trinity Watershed Management.*
19. On the final plat, show the natural channel set back from the crest of the natural channel. *Section 51A-8.611(d), Trinity Watershed Management.*
20. Prior to submission of the final plat, set floodway monument markers and provide documentation that the monuments have been set. *Section 51A-8.617(d)(1), (2), (3), and (4)*
21. Provide information regarding Fill Permit or Floodplain Alteration Permit if such permit is applied for.

Survey (SPRG) Conditions:


22. Prior to final plat, submit a completed final plat checklist and all supporting documents.
23. Show recording information on all existing easements within 150 feet of property.


Dallas Water Utilities Conditions:


24. Additional design information is required for assessment. Site plan must be submitted showing proposed development, building finished floor elevation, development, existing mains – including downstream manhole, and proposed water and wastewater service locations. Submit water/wastewater engineering plans to 320 E. Jefferson Blvd., Room 200, Attention: Water and Wastewater Engineering.
25. Water and wastewater main improvement may be required by Private Development Contract. Submit water/wastewater engineering plans to 320 E. Jefferson Blvd., Room 200, Attention: Water and Wastewater Engineering.
26. Existing and any proposed Water and Wastewater Easements must be shown and/or increased to conform to current design standards. Notice: Minimum DWU easement size 20' for one utility and 25' for both water and sewer. Larger diameter or deeper mains may require additional width.

Street Light/ Street Name/ GIS, Lot & Block Conditions:

27. Plans must comply with City's street lighting standards. See illumination standards in Street Design Manual.
28. On the final plat, add "Lyndon B. Johnson Freeway/ Interstate Highway No. 635."
29. On the final plat, identify the property as Lots 1A and 2A (north lot) in City Block C/8052.

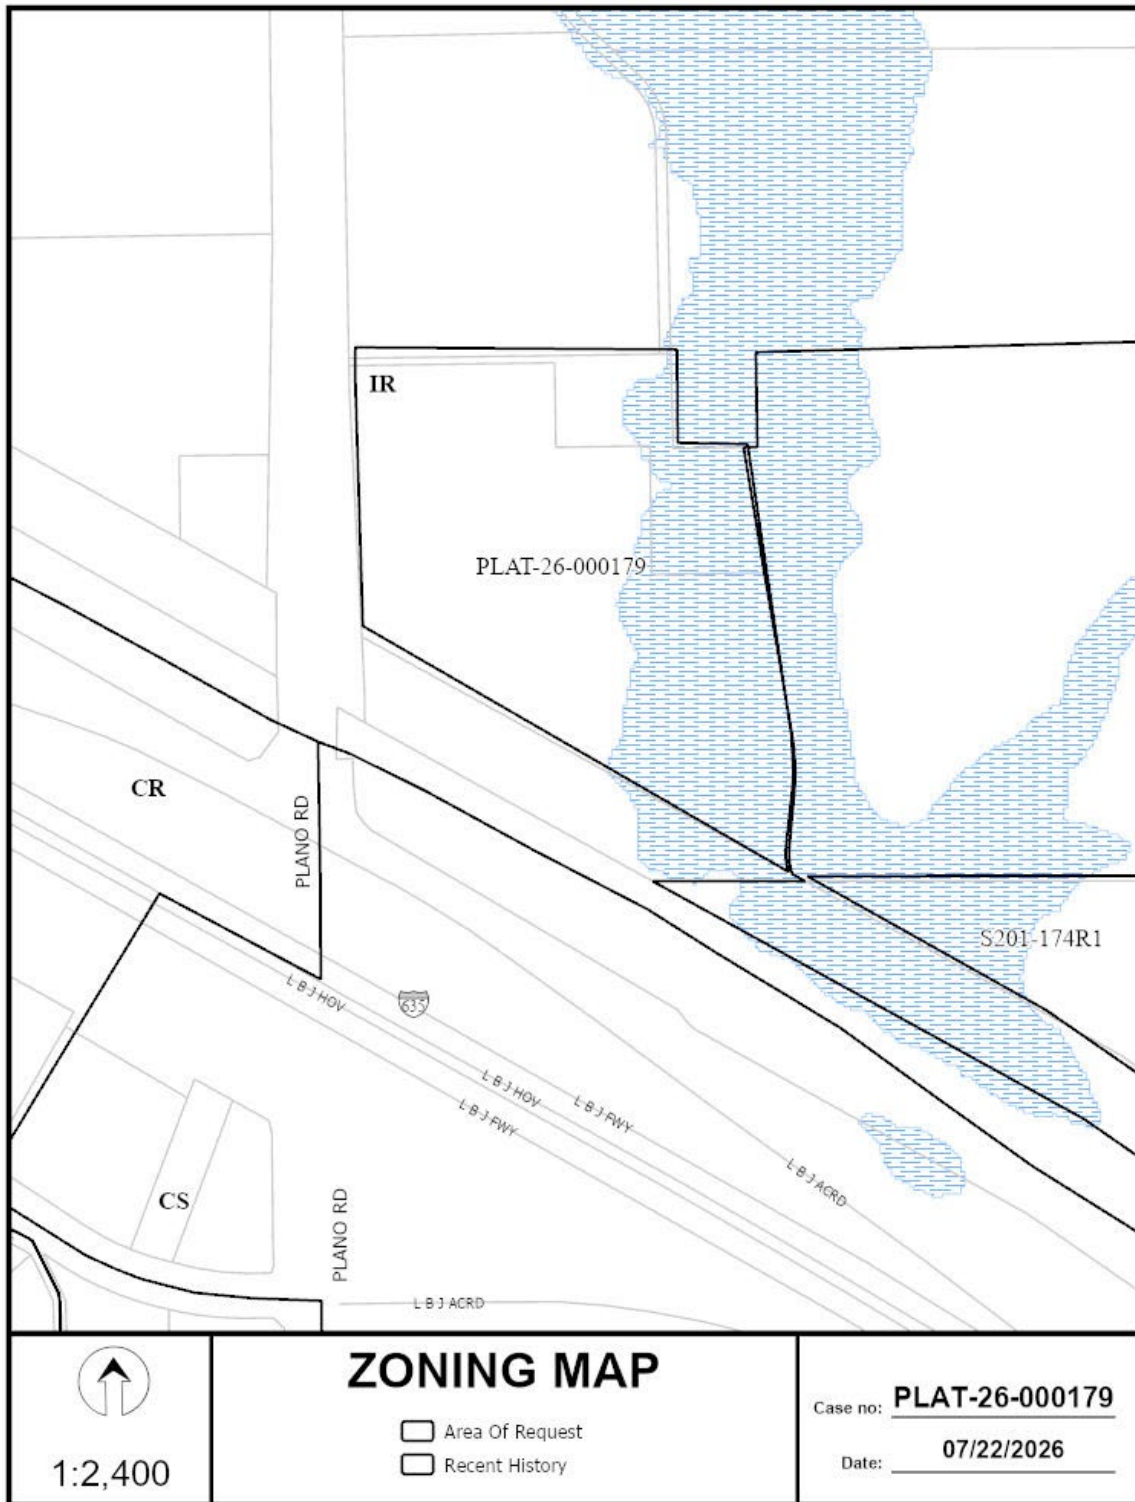

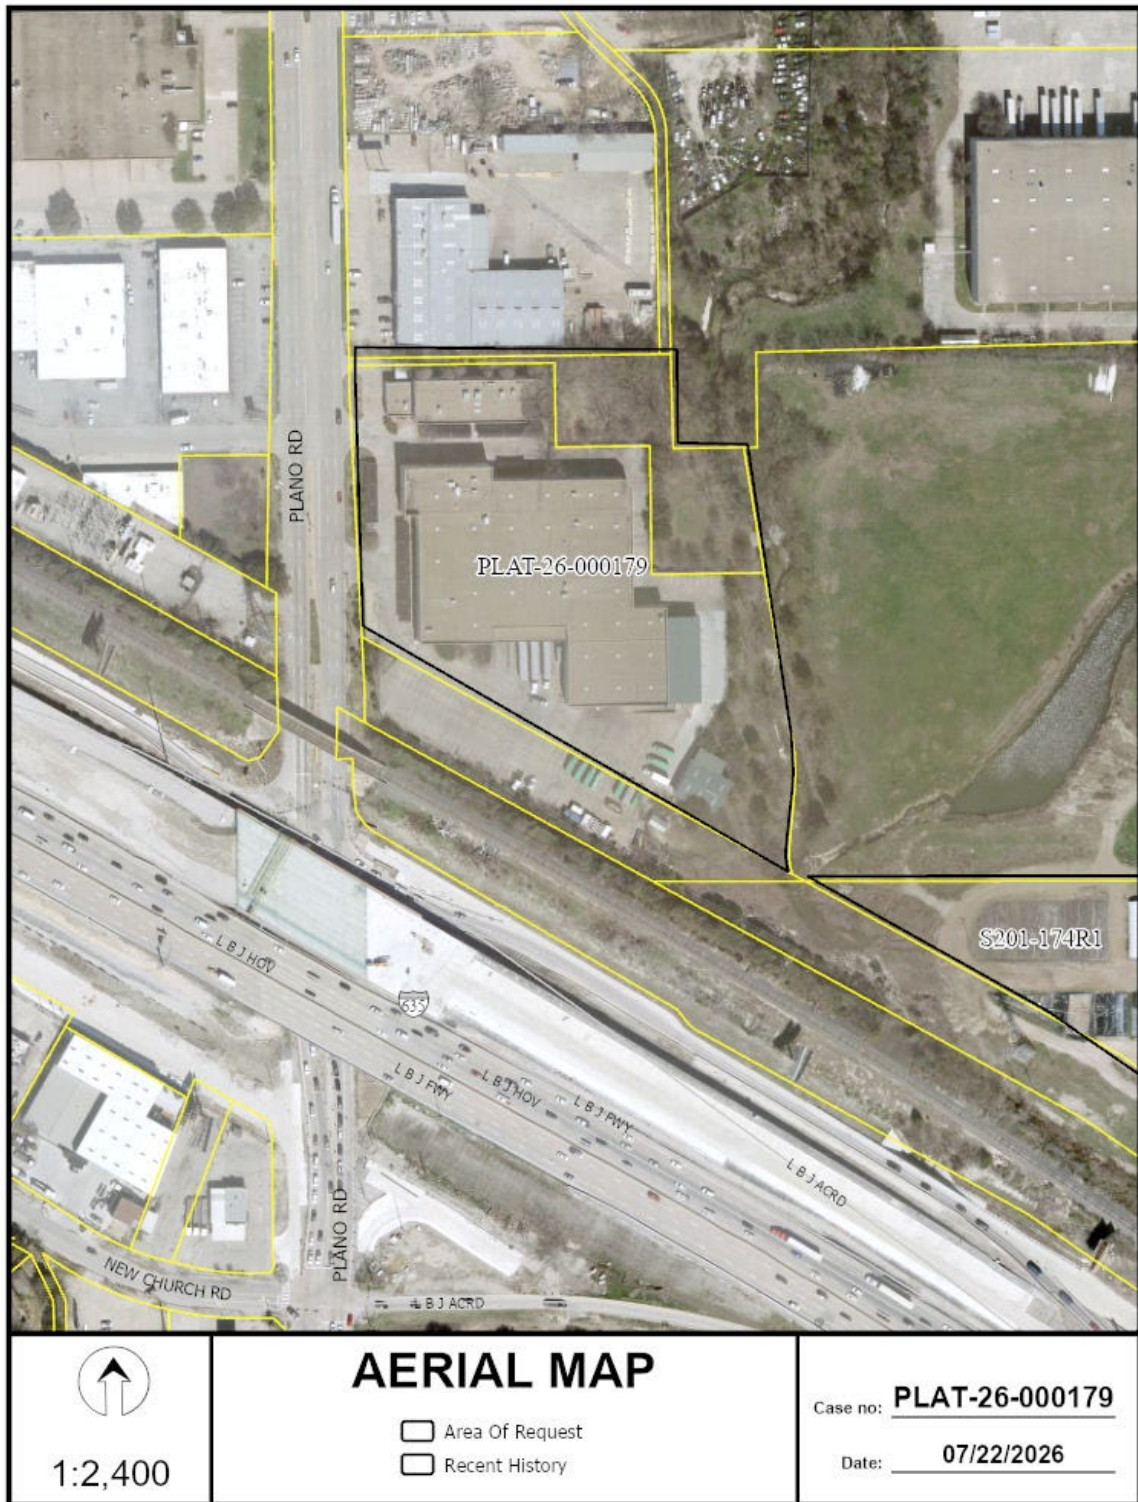

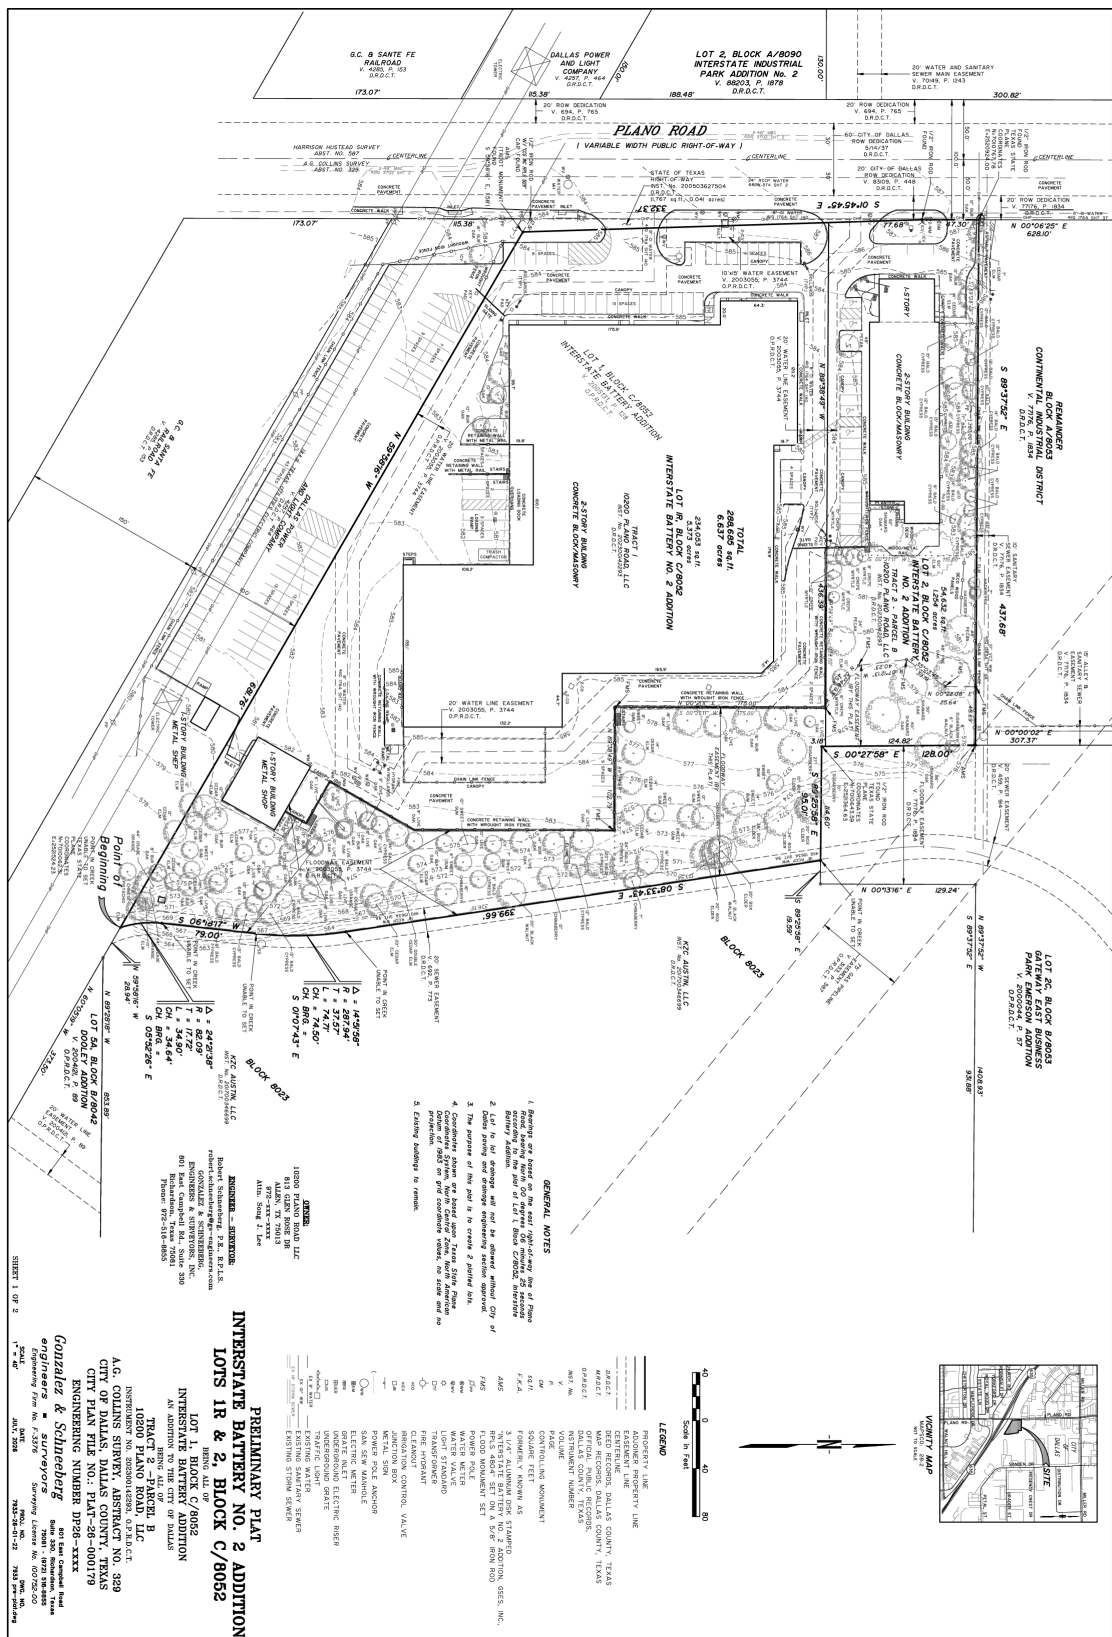

SURVEYOR'S STATEMENT

This job was prepared under my direct supervision, and was prepared during field operations and other reliable documentation.

RELEASED 7/6/2026 - FOR REVIEW ONLY
NOT TO BE RECORDED

Robert W. Schenckberg
Texas Registered Professional Land Surveyor No. 4804

BEFORE ME, the undersigned authority, a Notary Public in and for said State, on this day personally appeared Robert W. Schreiner, known to be the person whose name is subscribed to the foregoing instrument, and acknowledged to me that he executed the same for the purposes and consideration therein expressed, and in the capacity therein stated.

Given under my hand and seal of office this _____ day of _____, 2026.

Mayor Public in and for the State of Texas

of the
Weeks
for or
Dollars

ion D

ity Plan Commiss